

## Habibur Rahman


**From:** Arunangshu Paul <paul@cross-world.com>  
**Sent:** Thursday, September 12, 2019 10:01 AM  
**To:** Md. Ziaul Islam  
**Cc:** Maruf Ahmed; Md. Habibur Rahman Javed; Shipan Barua; Md. Mizanur Rahman  
**Subject:** FW: Order Confirmation for 30,000 Liters Fuel Tank of 1500 KVA Diesel Generator - 3 Units  
**Attachments:** 30KL UNDERGROUND FUEL STORAGE TANK DETAILS DRAWING.PDF; P&ID FOR FUEL SYSTEM.PDF; PLANT ROOM LAYOUT WITH FUEL TANK LOCATION.PDF; Opsonin Pharma.Fin-Fuel Tank.pdf; Fuel Tank-30000Ltr-BOQ.XLSX

Dear Zia Vhai

Please find the bellow mail of Confirmation mail for 30000 Ltr Fuel tank Job and the Confirmed value is BDT 20,00,000.00 (Including VAT & AIT). They request us to finish that job within 15 days from the confirmation date.

So, please take necessary steps to start and finish that job within that given time  
ame.

Arunangshu Paul | CROSS WORLD POWER LTD | Manager, Sales | Plot 1/B, Road 90, Gulshan - 2, Dhaka 1212, Bangladesh | p: +880 2 881 1858, 989 1442 | f: +880 2 881 5160 | m: 01755514747 | e: [paul@cross-world.com](mailto:paul@cross-world.com) | w: [www.cross-world.com](http://www.cross-world.com)

 please consider the environment before printing this email

**From:** COM-Mahbubur Rahman-KAYES [<mailto:kayes@opsonin.net>]  
**Sent:** Wednesday, September 11, 2019 7:13 PM  
**To:** Arunangshu Paul; Md. Mizanur Rahman  
**Cc:** NEW-PLANT- Hishab Uddin Ahmed-HUA; COM-A F M Enamul Haque-ENAMUL; BSL-IT- Jahidul Islam Shuman-JIS; COM-Aksem Ali-AKSEM  
**Subject:** RE: Order Confirmation for 30,000 Liters Fuel Tank of 1500 KVA Diesel Generator - 3 Units

Dear Sir,

Thanks for your coming & nice conversation with us. Please consider this mail as an Order Confirmation for 30,000 Liters Fuel Tank of 1500 KVA Diesel Generator - 3 Units considering the Total Value of Tk. 20,00,000/=

We will issue the Work Order Soon. Please arrange immediately. Also be informed that our technical team are not satisfied on your after sales service. Hope you understand & overcome the matter as soon as possible.

**Acknowledgement of this mail will be highly appreciable.**

**Thanks & Best Regards**

**Mahbubur Rahman Kayes**

Commercial


Opsonin Pharma Limited

Cell: +88 01730034334

IP: 2035 & Ext: 1414



# CROSS WORLD POWER LTD

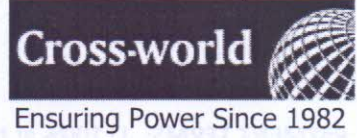

## FINANCIAL OFFER

Opsonin Pharma Limited  
30, New Eskaton Road, GPO Box # 2962,  
Dhaka-1000

DATE : Sep 09, 2019  
REF : CWPL-AM/2964/19F

### FINANCIAL OFFER FOR SUPPLY OF NEW 30000 LITER UNDERGROUND FUEL TANK WITH RELATED ACCESSORIES

Dear Sir,

We are pleased to submit our financial offer with reference to our technical offer# CWPL-AM/2964/19T dated Sep 09, 2019 :

#### 1. Price:

SL #	Product Name	Unit	Price (BDT)	Qty.	Total Price(BDT)
1)	New 30000 Liter Underground Fuel Tank With Related Accessories (As Per Attached)	Set	2,500,000.00	1.00	2,500,000.00

Total Price (Ready Stock) in BDT 2,500,000.00

GRAND TOTAL (Including VAT & AIT) in BDT 2,500,000.00


Amount in words : BDT Two Million Five Hundred Thousand Only.

Approved : 20,00,000/-







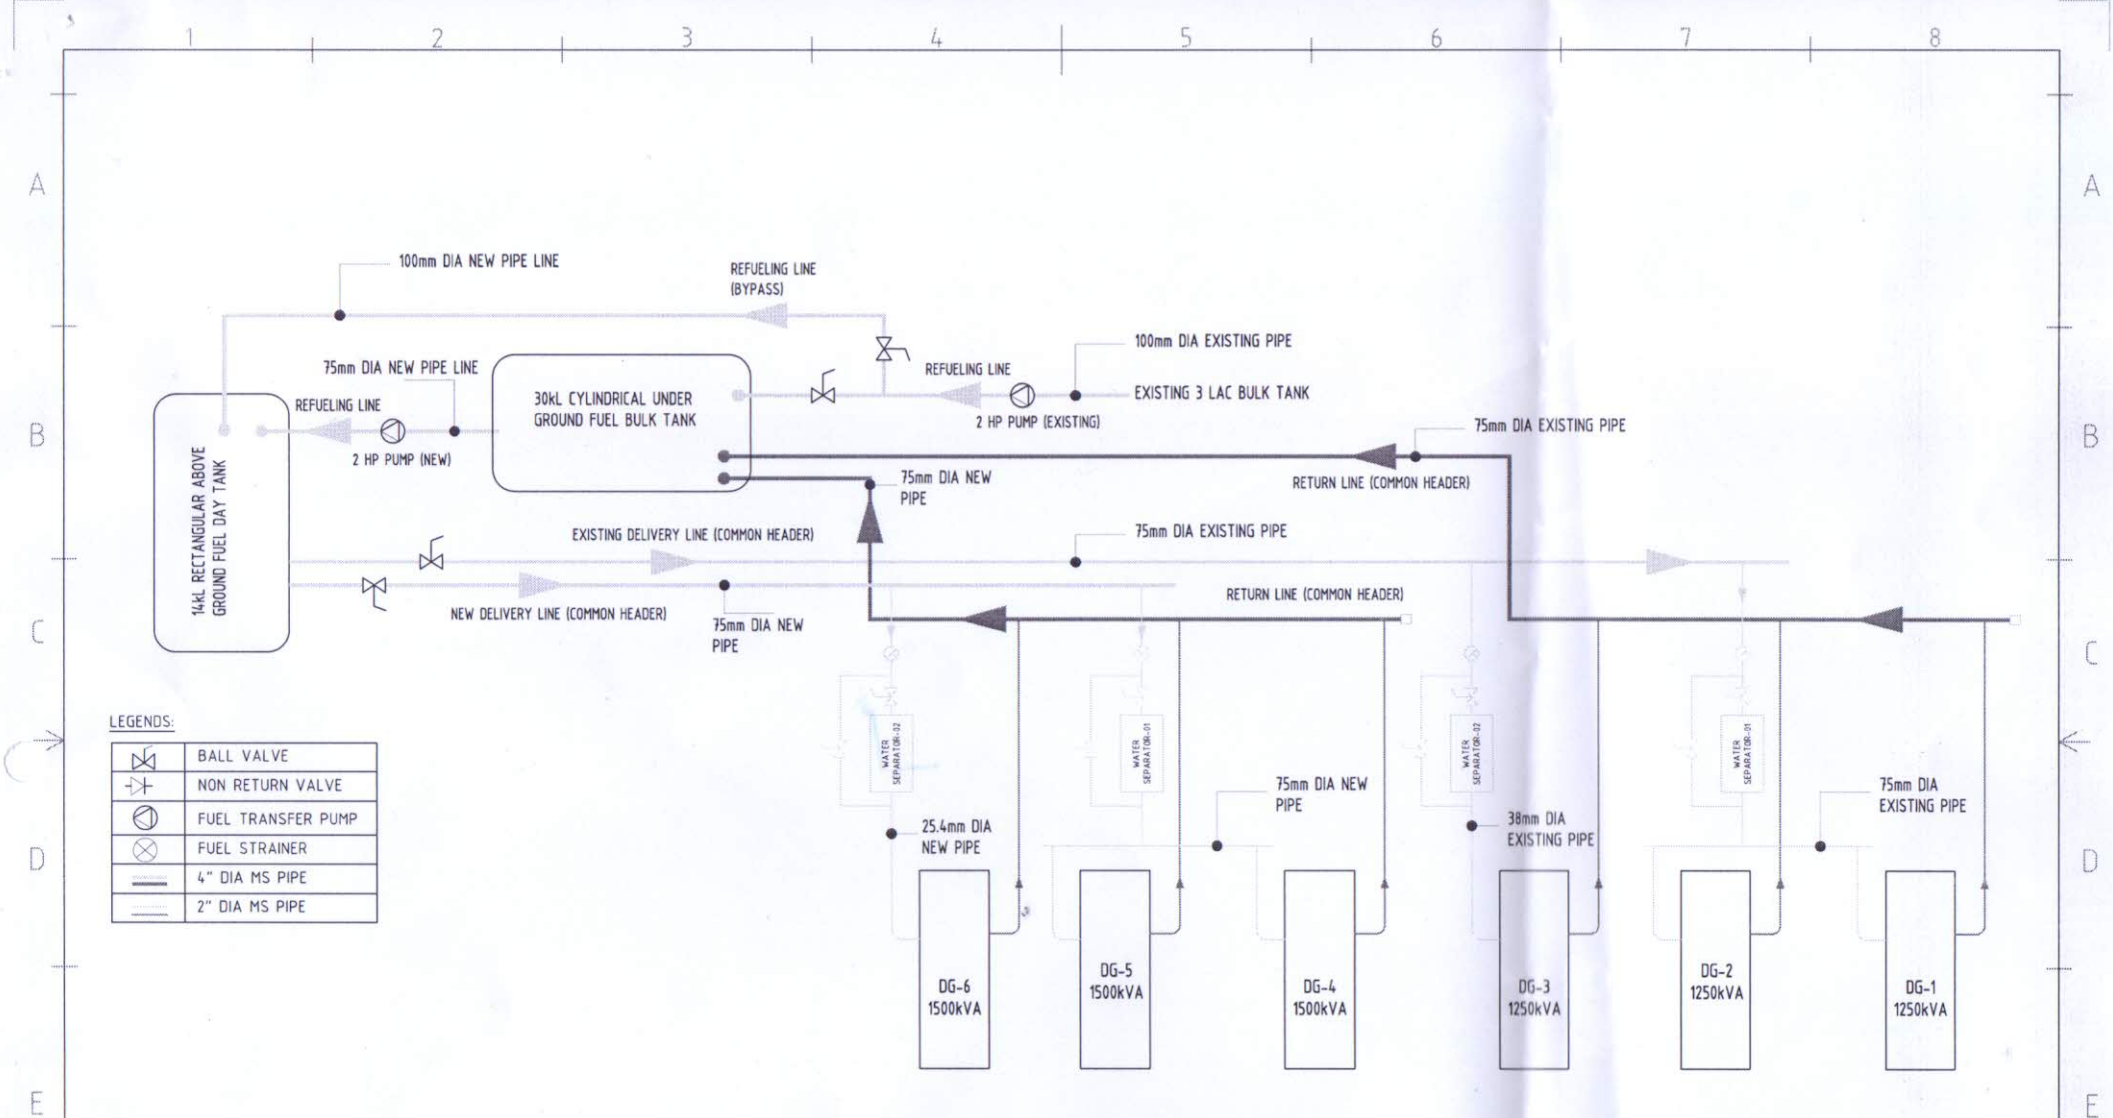

LEGENDS:

	BALL VALVE
	NON RETURN VALVE
	FUEL TRANSFER PUMP
	FUEL STRAINER
	4" DIA MS PIPE
	2" DIA MS PIPE

P&ID OF FUEL LINE

			DESIGN BY MMR	CHECKED & APPROVED BY SSS	DIMENSION IN mm	Cross-world Cross World Power Ltd. House N8(O) 04, Road 92, Gulshan-2, Dhaka-1212, Bangladesh Tel: (+8802) 9811805, 9891442 Fax: (+8802) 9811806 Web Site: www.cross-world.com	
			TITLE: PROPOSED FUEL SYSTEM P&ID FOR 3X1250kVA+3X1500kVA DG.				
			PAPER SIZE A3	SCALE NTS	CLIENT -OPSONIN PHARMA (BARISAL)		DWG NO-
ISSUE	ALTERATION DESCRIPTION	RCC	REINFORCEMENT CEMENT CONCRETE	DATE:- 24.07.19			



## CROSS WORLD POWER LIMITED

## BOQ FOR 30000 LITER UNDERGROUND FUEL TANK AT BARISAL

## PROJECT: OPSONIN PHARMA

SI No.	Description		Unit	Quantity	Remarks
1	FUEL STORAGE TANK				
1.1	NEW 30000 LITER UNDER GROUND FUEL TANK.	30000 liter horizontal cylindrical fuel Storage under ground bulk fule tank made with MS sheet <b>8mm thick</b> , Over flow, gate valve, Ladder, Air Vent & necessary fittings. Tank Dimension: L X Dia 25 FT X 12 FT (or Equivalent)	Pcs	1	
1.2	For Delivery Line common	Ø75mm (inner), Seamless Mild Steel Pipe; Elbow, Tee, Flange, Nut-bolt, Waher, Gasket, etc as required Welding Joint, leak testing, outside Red-oxide & Enamel Painted.	Meter Approx.	55	
1.3	For Return Line common	Ø75mm (inner), Seamless Mild Steel Pipe; Elbow, Tee, Flange, Nut-bolt, Waher, Gasket, etc as required Welding Joint, leak testing, outside Red-oxide & Enamel Painted.	Meter Approx.	55	
1.4	For refueling line from Main bulk tank	Ø100mm (inner), Seamless Mild Steel Pipe; Elbow, Tee, Flange, Nut-bolt, Waher, Gasket, etc as required Welding Joint, leak testing, outside Red-oxide & Enamel Painted.	Meter Approx.	20	
1.5	For individual delivery & return line	Ø25mm (inner), Seamless Mild Steel Pipe; Elbow, Tee, Flange, Nut-bolt, Waher, Gasket, etc as required Welding Joint, leak testing, outside Red-oxide & Enamel Painted.	Meter Approx.	55	
1.6	Fuel/Water Separator	SWK 2000/40 Brand: Separ	Pcs	2	Foreign
1.7	Pump (Electric)	2Hp SP Motor	Pcs	1	Water Pump
1.8	Fuel Pipe Plumbing works & Accessories	Accessory like fittings like ,L bow,T joint,I joint , Converter, socket, niple etc for fuel pipe & plumbing to day fuel tank. Ball Valve 25mm dia-4nos; 75mm dia ball valve-2 nos, 100mm dia ball valve-2nos, Fuel stainer 75mm dia 2nos.	Job	1	
1.9	Supply, Installation & Commissioning of MCC panel	2Hp motor starter (DOL), SP, 50Hz, 2900rpm with necessary relay, timer, on/off switch etc. Required to operate the pump automatically start/stop.	Unit	1	

**NB** - ALL TYPE OF CIVIL WORKS HAS BEEN EXCLUDED FROM ABOVE BOQ AND CLIENT IS RESPONSIBLE FOR THOSE WORKS & MATERIALS . CWPL IS NOT LIABLE FOR ANY DELAY DUE TO CIVIL EXECUTION & ERECTION WORKS. BOQ HAVE MADE BASED ON PRELIMINARY DRAWING.IT WAY VARY.